


Underground Storage Tank System Monitoring Well Detail

(not to scale)

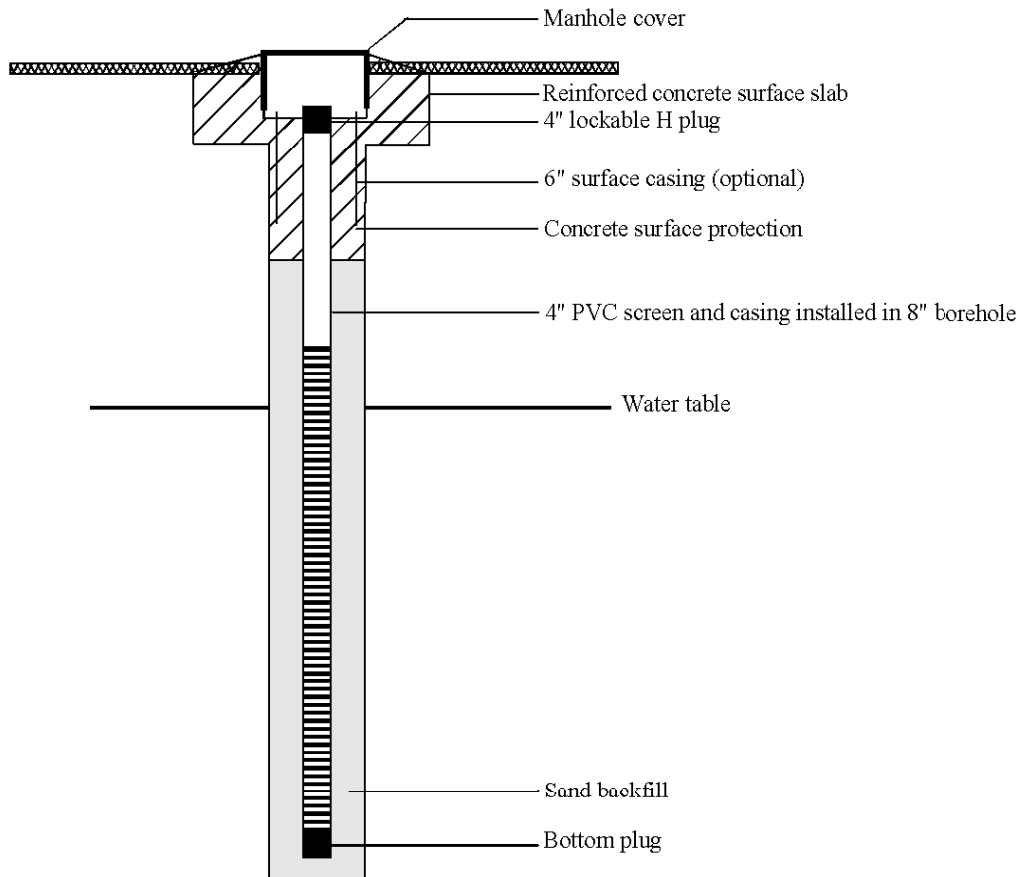

Notes

- 1 Water table elevation is site specific
 - 2 Screened section to be installed from 1' above water table to approximately 10' below water table
 - 3 Manhole cover 12" diameter, lockable and limited access
 - 4 Slot size of screen 0.01", filtersock may be used in sandy soil conditions
 - 5 Sand backfill: Silica sand 6-20 sieve size
 - 6 Concrete surface protection to extend minimum 3' below ground level
 - 7 Provide Water Authority Cayman with keys for manhole cover and H plug
 - 8 All equipment and materials to be free of hydrocarbons to prevent contamination of the monitoring well
- Update 10 October 2000