



SEPTIC TANK

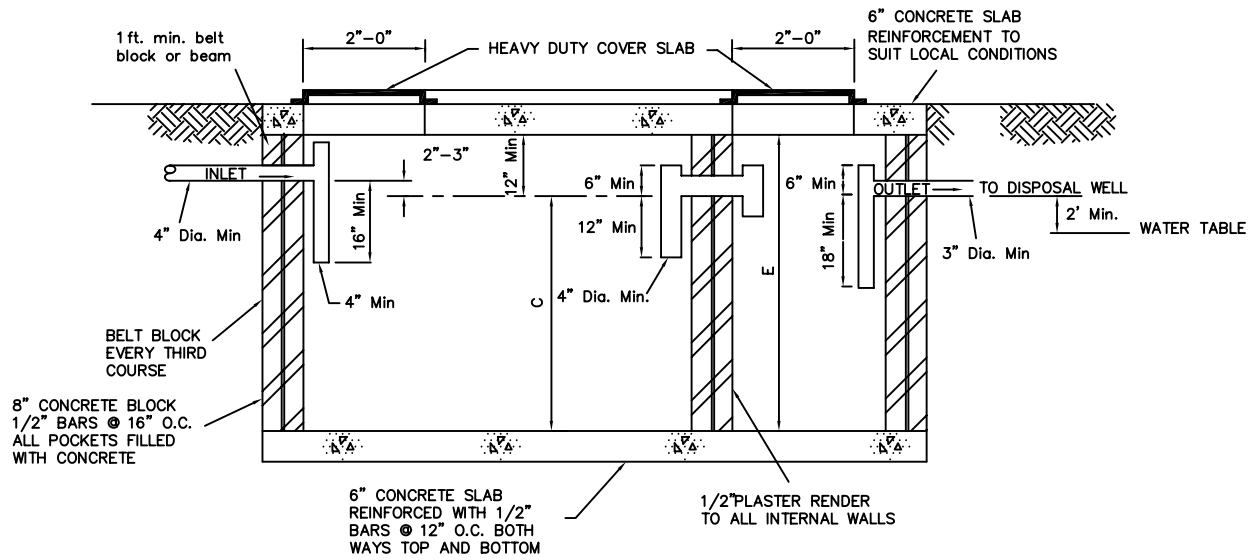

NOT TO SCALE

1. Levels of ground and ground water shown are ideal. Local site conditions will determine actual levels

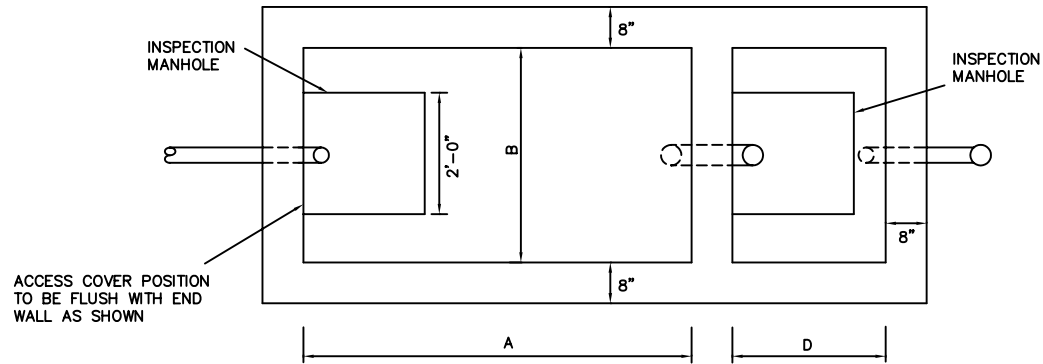

SEPTIC TANKS					
Normal Dimensions					
Gal.	A	B	C	D	E
750	5'0"	3'6"	4'0"	2'6"	5'0"
1000	6'0"	3'6"	4'6"	3'0"	5'6"
1250	6'6"	4'0"	4'6"	3'6"	5'6"
1500	7'0"	4'6"	4'6"	3'6"	5'6"
1750	7'0"	5'0"	4'6"	4'0"	5'6"
2000	8'6"	5'0"	4'6"	4'6"	5'6"
2250	8'6"	5'6"	4'6"	4'6"	5'6"
2500	8'6"	5'6"	5'0"	4'6"	6'0"

SCALE	1/4" = 1'-0"
M.T.S.	NEW
SHEET	0

SEPTIC TANK STANDARD DETAIL

GENERAL DETAILS

WATER AUTHORITY - CAYMAN
P.O. BOX 1104, GEORGETOWN
CAYMAN ISLANDS
345-949-6352

REV	DATE	BY	DESCRIPTION
0			ORIGINAL RELEASE

DATE	12/14/79
PROJECT NO.	